




# Big Hermet Pressure Detectors with Hermetically Sealed Electrical Detecting Elements

## General Instructions

This instruction provides information for Installation, Process Connection, Electrical Connection, and Calibration of SOR Pressure Detectors with hermetically sealed, explosion proof electrical detecting elements. The Static “O” Ring type pressure detector with optional wetted parts is suitable for a wide variety of process applications. See Big Hermet Catalog 455 for details. This type is not recommended for high-pressure, fluid-power applications where high-shock pressure and high cycle rates are expected.

If you suspect that an instrument is defective, contact the factory or the SOR representative in your area for a return authorization number. If the instrument cannot be returned for service, field work should be performed by a qualified instrument technician using factory authorized procedures. Contact the factory or the SOR representative in your area for technical support.

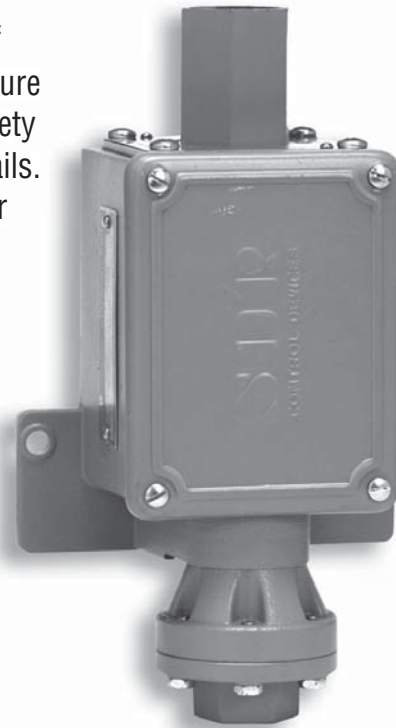

**NOTE: If you suspect that a product is defective, contact the factory or the SOR® Representative in your area for a return authorization number (RMA). This product should only be installed by trained and competent personnel.**

### Table of Contents

*Design and specifications are subject to change without notice.*

*For latest revision, go to [www.sorfinc.net](http://www.sorfinc.net)*

Installation .....	2
SIL Installation .....	2
Process Connection .....	2
Electrical Connection.....	3
Calibration Procedure .....	4
Special Conditions for Safe Use .....	4
Dimensions .....	5-7

## Installation

Ensure that the wiring conforms to all applicable local and national electrical codes and install unit(s) according to relevant national and local safety codes.

- Secure the housing mounting pad to a bulkhead, panel rack or pipe stanchion with suitable 1/4" bolts.
- Line mounting by either process connection or electrical conduit connection is not recommended.
- Suggested mounting orientation is electrical conduit connection at 12 o'clock and process pressure port at 6 o'clock. However, the device can be mounted in any position. Breather drains are located on the housing back wall. Breather drains must be kept clear of paint and foreign matter.

## Safety Integrity Level (SIL) Installation Requirements

The SOR pressure detectors have been evaluated as Type-A safety related hardware. To meet the necessary installation requirements for the SIL system, the following information must be utilized:

- Proof Test Interval shall be one year.
- Units may only be installed for use in Low Demand Mode.
- Products have a HFT (Hardware Fault Tolerance) of 0, and were evaluated in a 1001 (one out of one) configuration.

Form 1538 (03.12) ©2012 SOR Inc.

## Process Connection


Securely connect process line to pressure port using two wrenches: one to hold hex flats on pressure port, the other to tighten process pipe or tube fitting.



***Failure to mount the housing on a flat mounting surface may result in torsional forces on the housing that could cause false trips or render the pressure detector inoperative. Use care not to loosen port from body or body from housing.***





***Inadvertent movement of the over-travel adjustment screw will degrade performance and could render the device inoperative, unless factory authorized procedures are followed.***

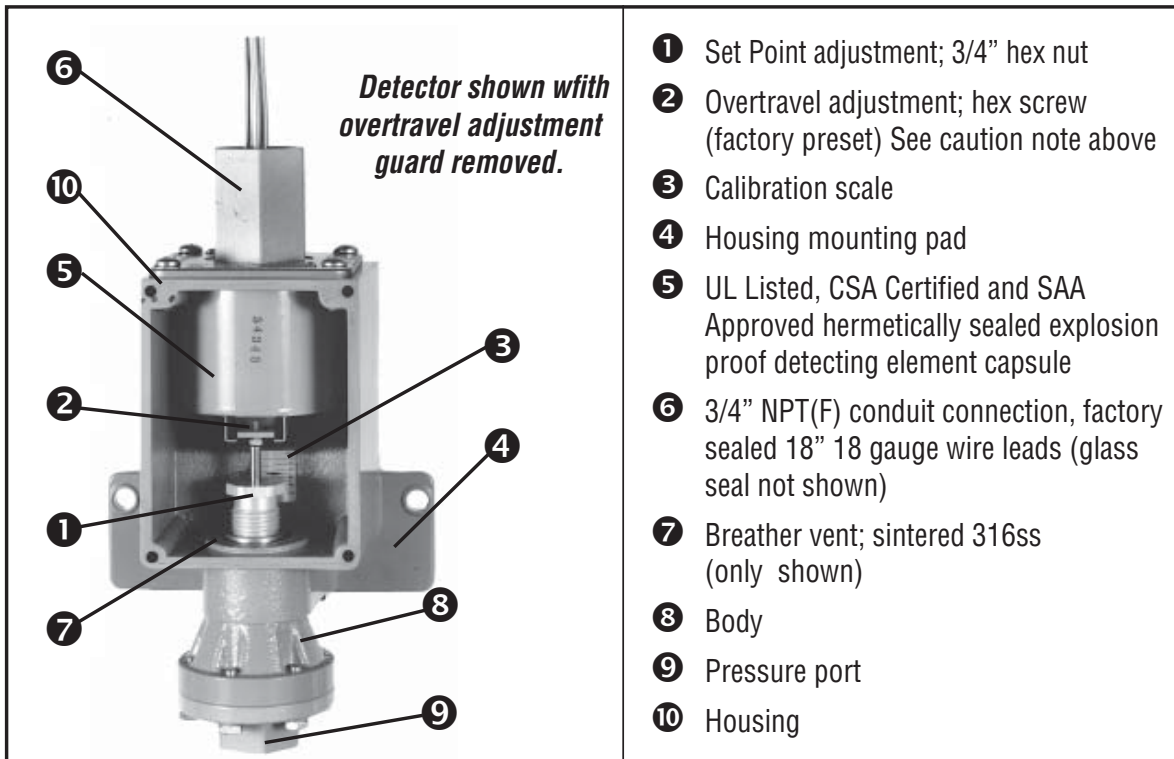

## Electrical Connection

Electrical connections are free leads; 18 gauge, 18" with ground wire and 3/4 NPT(F) conduit connection. Use two wrenches: one to hold hex conduit connection, the other to tighten conduit fitting. The hermetically sealed, explosion proof detecting element capsule has UL Listed/CSA Certified factory-sealed leads. Consequently, an external seal fitting is not required between the pressure detector and junction box of the external electrical circuit.

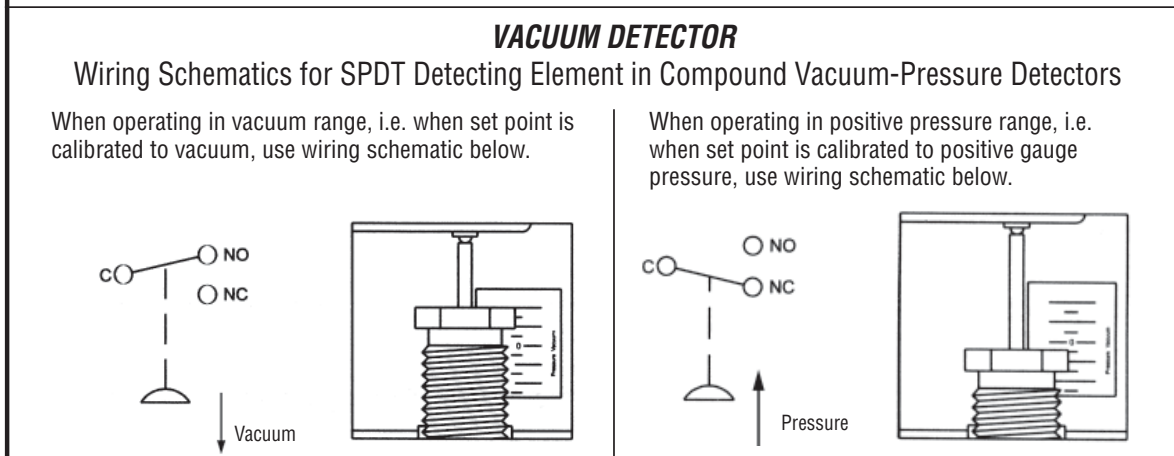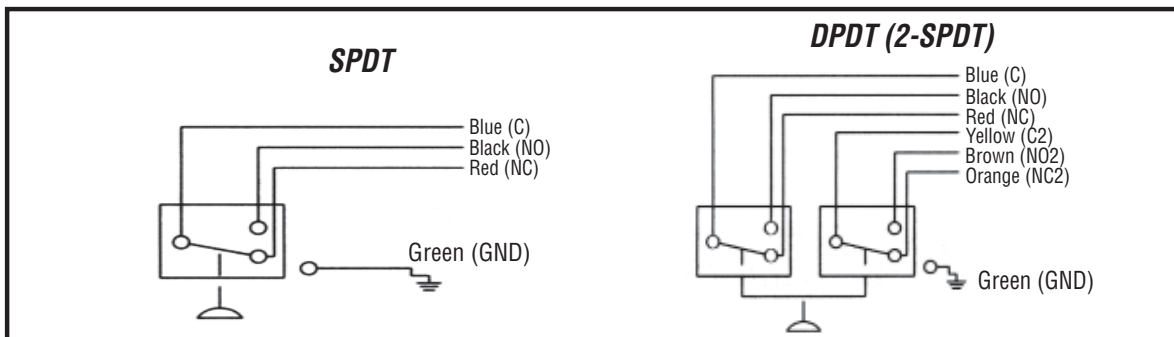

## Calibration Procedure



*Detecting Element Capsule Assembly has been precisely positioned in the housing and overtravel adjusted at the factory for optimum performance. Any inadvertent movement or replacement in the field will degrade performance and could render the device inoperative, unless factory authorized procedures are followed.*

- ❶ Remove weathertight cover from housing. It is unnecessary to disconnect electrical power because the hermetically sealed detecting element capsule maintains explosion proof integrity.
- ❷ Use 3/4" open-end wrench to turn hex adjusting nut clockwise to increase set point; counterclockwise to decrease set point. Approximate set point can be obtained by sighting across top of adjusting nut to calibration scale on interior wall of housing. If precise set point calibration is required, it will be necessary to use a regulated pressure source, a suitable continuity tester, and a 1/4% or better test gauge.
- ❸ Replace housing cover and gasket to ensure weathertightness.

## Special Conditions for Safe Use


- The terminal box to which the equipment is attached must, together with the detector, ensure the requisite thread engagement for Apparatus Group IIC.
- The permanently attached cables are to be suitably terminated and protected from impact.
- When the detector is attached to an increased safety terminal box the assembly must be capable of withstanding the impact test specified in BS 5501: Part 1: 1977.
- The sealing arrangements must maintain the minimum IP54 rating required by the increased safety enclosure.
- The detector must attach to the enclosure using an existing entry.


# Dimensions

**NOTE:** Dimensions marked with an asterisk (\*) on housing dimension drawings vary with respect to process connection size. (See **A** on page 8).

## PISTON NUMBERS 12 & 52


## HOUSING DESIGNATOR: BA, BL

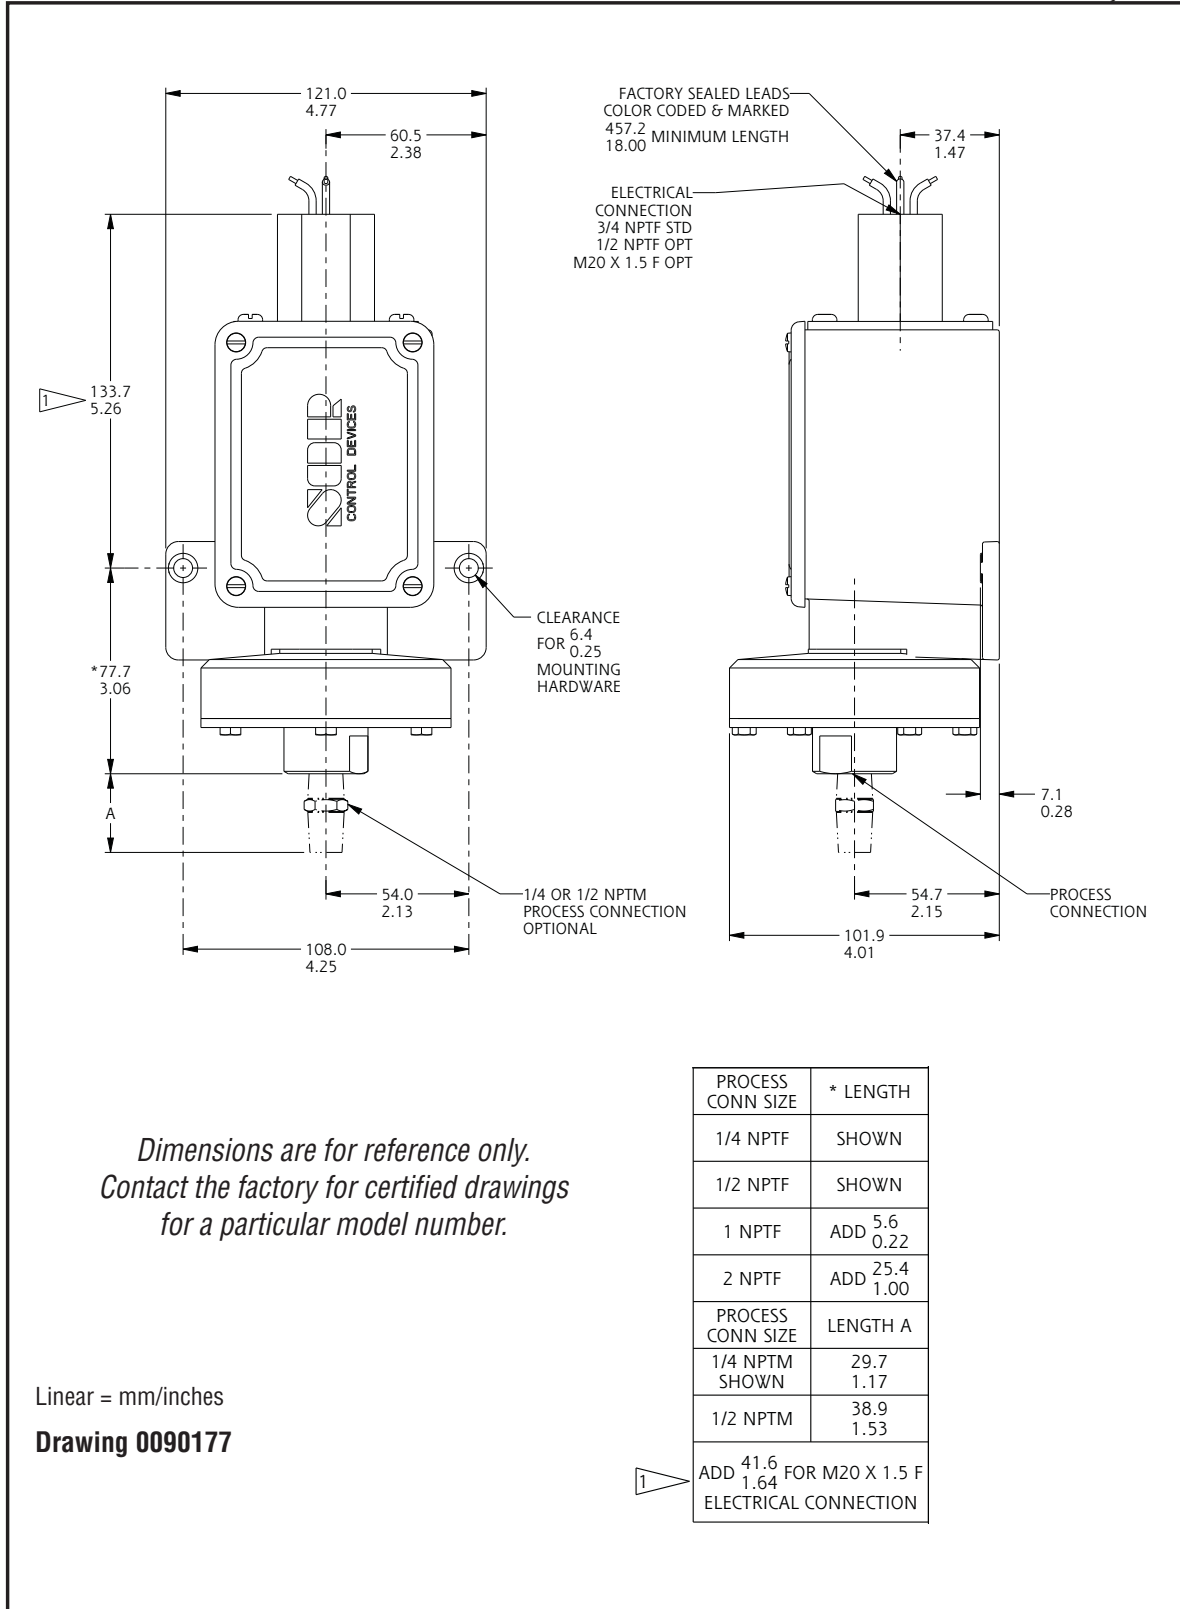

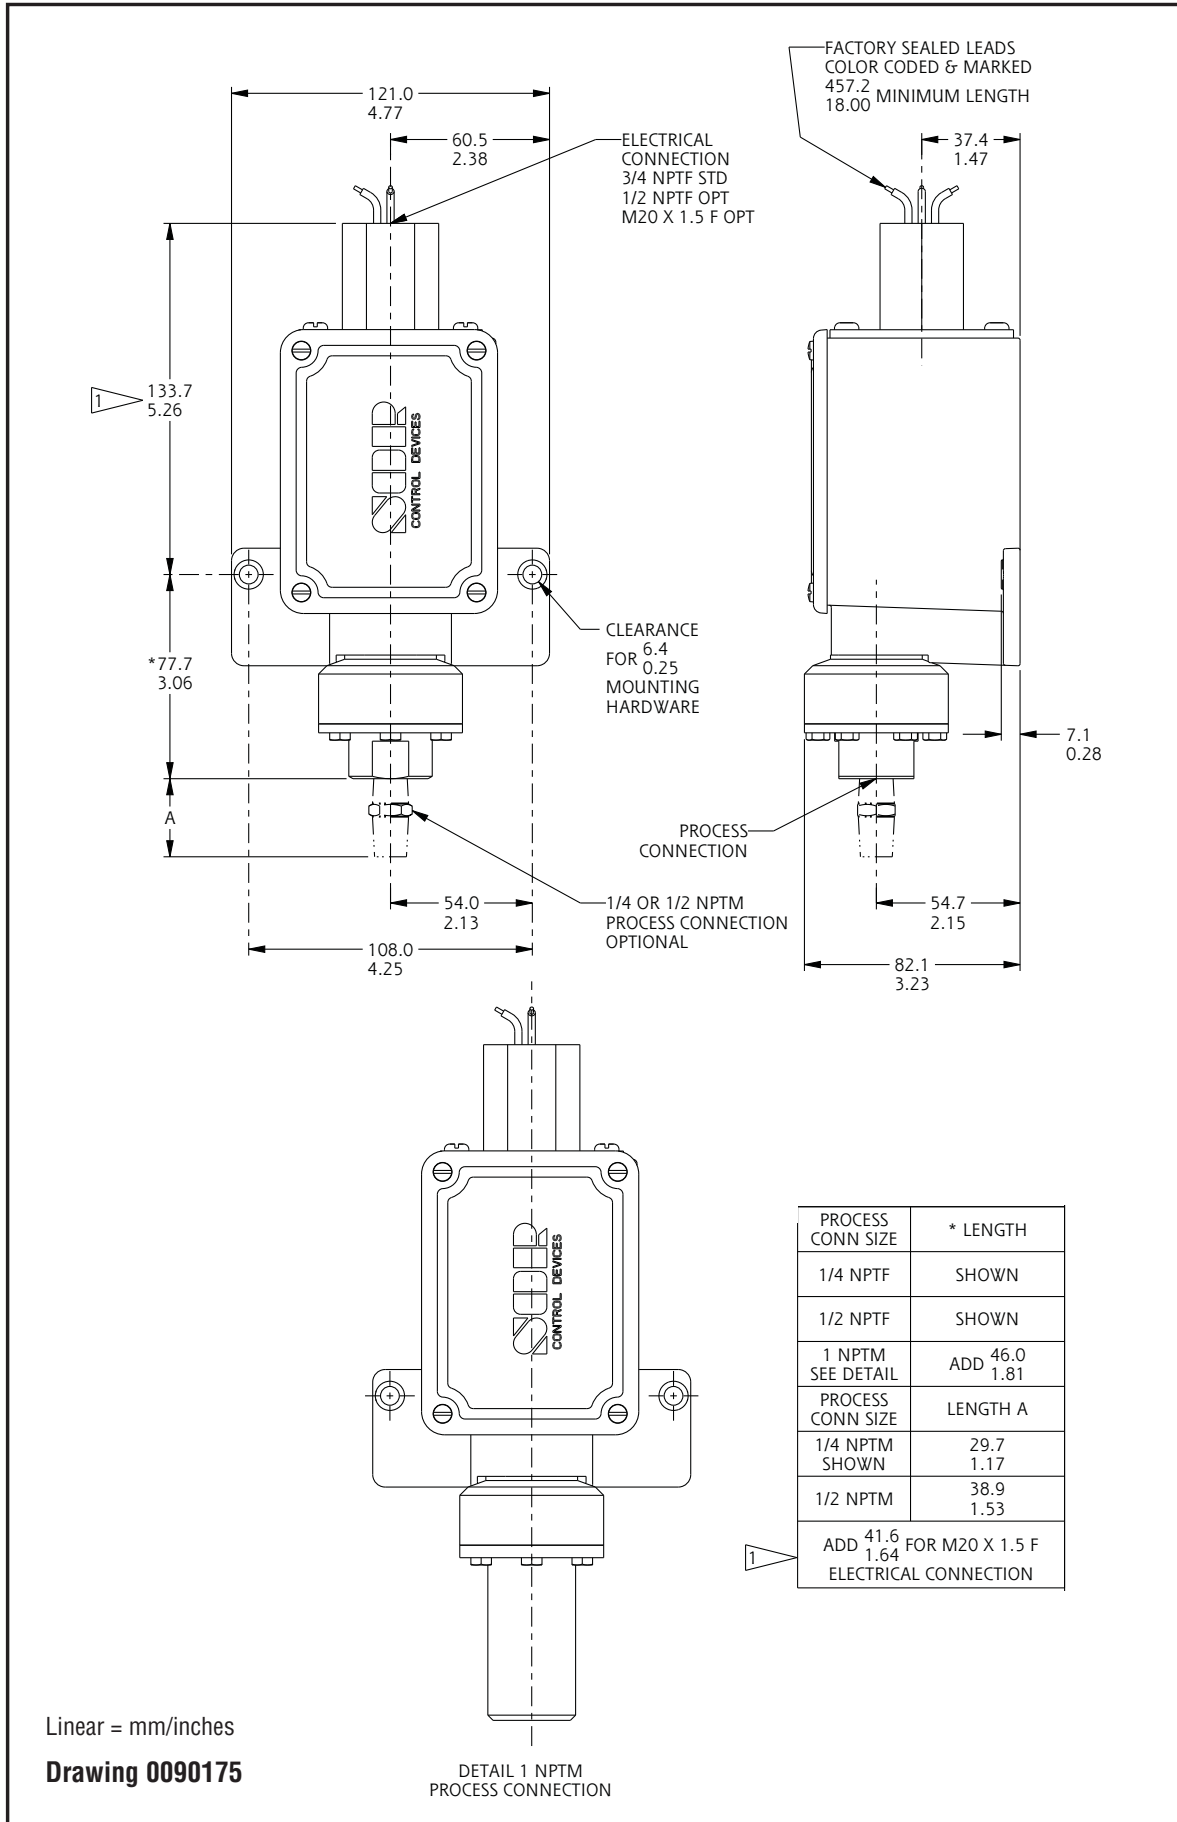

**PISTON NUMBERS 6, 5, 9, 1, & 56**

**HOUSING DESIGNATOR: BA, BL**

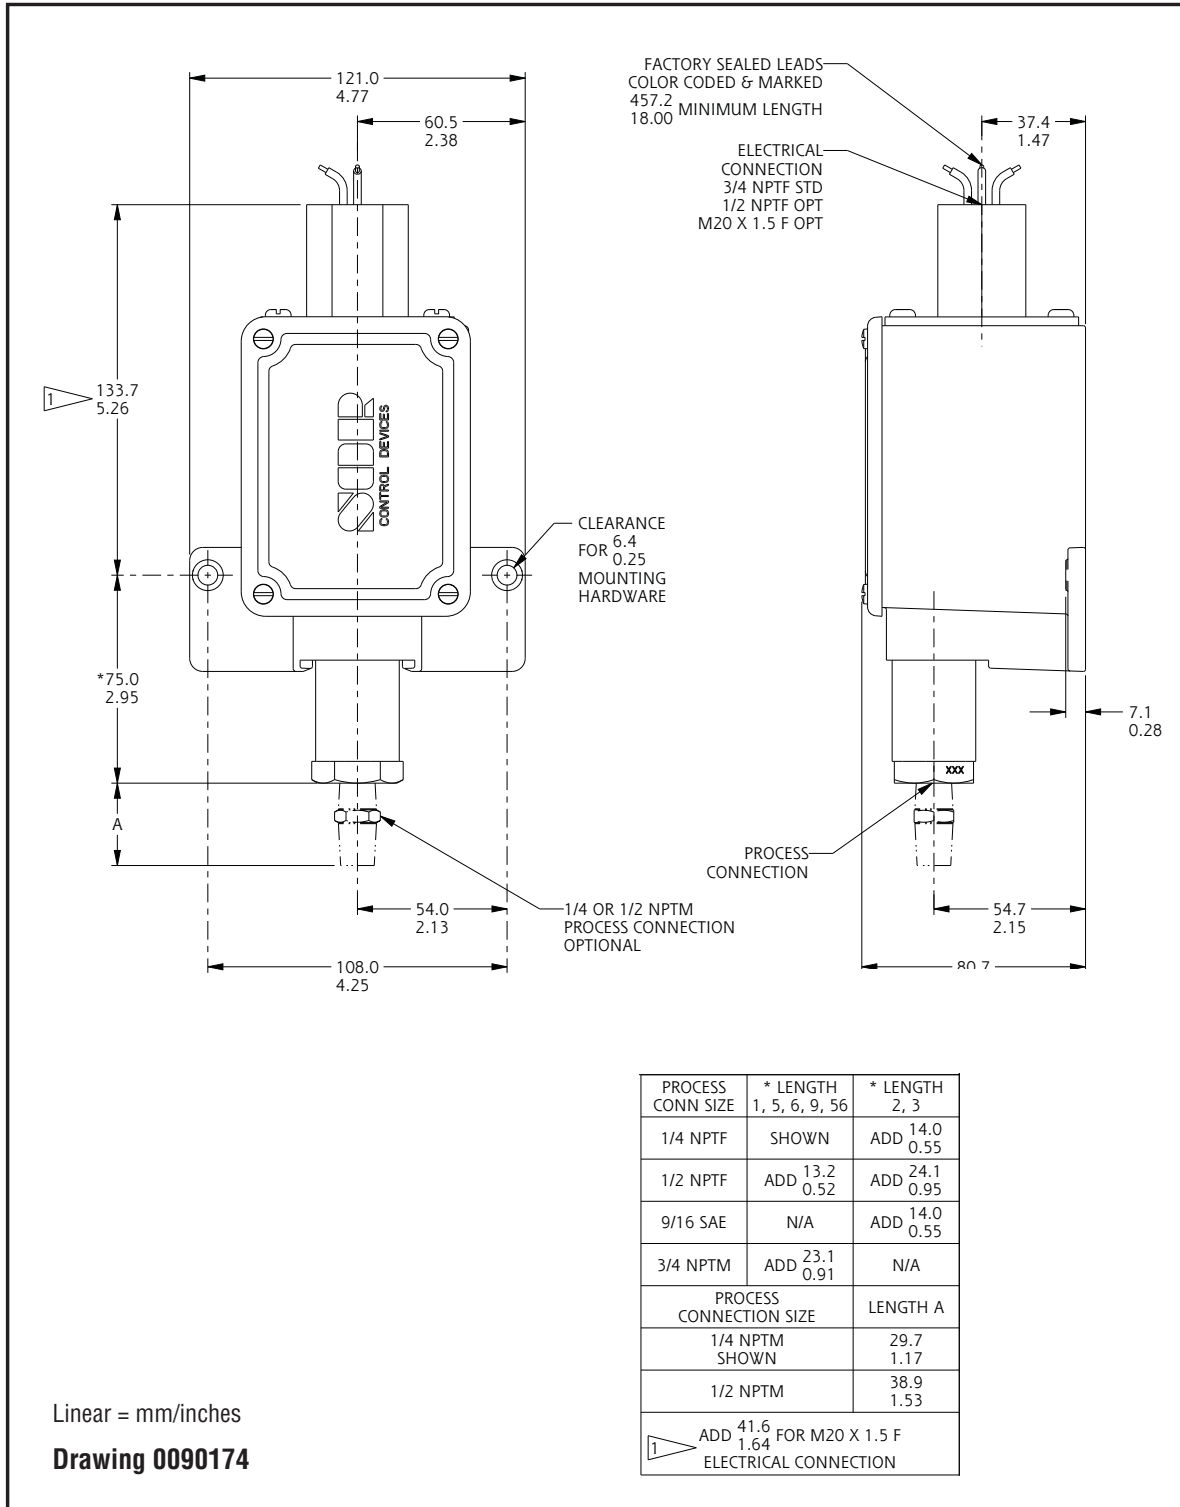

PROCESS CONN SIZE	* LENGTH 1, 5, 6, 9, 56	* LENGTH 2, 3
1/4 NPTF	SHOWN	ADD 14.0 0.55
1/2 NPTF	ADD 13.2 0.52	ADD 24.1 0.95
9/16 SAE	N/A	ADD 14.0 0.55
3/4 NPTM	ADD 23.1 0.91	N/A
PROCESS CONNECTION SIZE		LENGTH A
1/4 NPTM SHOWN		29.7 1.17
1/2 NPTM		38.9 1.53
1 ADD 41.6 FOR M20 X 1.5 F 1.64 ELECTRICAL CONNECTION		

Linear = mm/inches

**Drawing 0090174**

<b>A</b> <b>Process Connection Size</b>	<b>Piston Number</b>		
	<b>12, 52</b>	<b>4, 54</b>	<b>6, 5, 9, 1, 56</b>
1/4 NPT(F)	Shown	Shown	Shown
1/2 NPT(F)	Shown	Shown	Add $\frac{13.2}{0.52}$
3/4 NPT(M)	N/A	N/A	Add $\frac{23.1}{0.91}$
1 NPT(F)	Add $\frac{5.6}{0.22}$	N/A	N/A
1 NPT(M)	N/A	Add $\frac{46.0}{1.81}$	N/A
2NPT(F)	Add $\frac{25.4}{1.00}$	N/A	N/A
Length A 1/4 NPT(M)	Add $\frac{29.7}{1.17}$	Add $\frac{29.7}{1.17}$	Add $\frac{29.7}{1.17}$
Length A 1/2 NPT(M)	Add $\frac{38.9}{1.53}$	Add $\frac{38.9}{1.53}$	Add $\frac{38.9}{1.53}$



Printed in USA

[www.sorinc.net](http://www.sorinc.net)

14685 West 105th Street, Lenexa, KS 66215 ■ 913-888-2630 ■ 800-676-6794 USA ■ Fax 913-888-0767